



## OPEN ACCESS

## EDITED BY

Michael Folsom Toney,  
University of Colorado Boulder,  
United States

## REVIEWED BY

Mohamed Salem,  
University of Science Malaysia (USM),  
Malaysia  
Minh Quan Duong,  
University of Science and Technology,  
The University of Danang, Vietnam

## \*CORRESPONDENCE

Arsalan Muhammad Soomar,  
✉ [arsalan.muhammad.soomar@pg.edu.pl](mailto:arsalan.muhammad.soomar@pg.edu.pl)

RECEIVED 13 February 2023

ACCEPTED 22 May 2023

PUBLISHED 14 June 2023

## CITATION

Soomar AM, Guanghua L, Shaikh S,  
Shah SHH and Musznicki P (2023),  
Scrutiny of power grids by penetrating PV  
energy in wind farms: a case study of the  
wind corridor of Jhampir, Pakistan.  
*Front. Energy Res.* 11:1164892.  
doi: 10.3389/fenrg.2023.1164892

## COPYRIGHT

© 2023 Soomar, Guanghua, Shaikh, Shah  
and Musznicki. This is an open-access  
article distributed under the terms of the  
[Creative Commons Attribution License  
\(CC BY\)](https://creativecommons.org/licenses/by/4.0/). The use, distribution or  
reproduction in other forums is  
permitted, provided the original author(s)  
and the copyright owner(s) are credited  
and that the original publication in this  
journal is cited, in accordance with  
accepted academic practice. No use,  
distribution or reproduction is permitted  
which does not comply with these terms.

# Scrutiny of power grids by penetrating PV energy in wind farms: a case study of the wind corridor of Jhampir, Pakistan

Arsalan Muhammad Soomar<sup>1\*</sup>, Lyu Guanghua<sup>2</sup>, Shoaib Shaikh<sup>3</sup>,  
Syed Hadi Hussain Shah<sup>4</sup> and Piotr Musznicki<sup>1</sup>

<sup>1</sup>Faculty of Electrical and Control Engineering, Gdańsk University of Technology, Gdańsk, Poland, <sup>2</sup>Power China Huadong Engineering Co., Ltd., Hangzhou, China, <sup>3</sup>Department of Electrical Engineering, Mehran University of Engineering and Technology, Jamshoro, Pakistan, <sup>4</sup>Department of Electrical and Computer Engineering, Mohammad Ali Jinnah University Karachi, Karachi, Pakistan

This study examines the problems caused by intermittent renewable energy sources, especially wind farms, and suggests a different solar energy penetration strategy to improve their loading capacity. The study uses real-time data from a wind farm in Jhampir, Pakistan, to analyse and assess various aspects of grid stations connected to wind farms. Electrical Transient Analyzer Program is used to validate the results by linking these with actual grid system. The article focuses on creating a model for a grid connected to a wind farm and the simulation of outcomes following capacity expansion, with the installation of an autotransformer. The original capacity of the wind farm was 750 MW, which was increased to 1,250 MW, i.e., 1.66 times the actual capability. Furthermore, this capacity was further enhanced to 1,540 MW, which becomes 1.23 times the previous capacity by the penetration of a photovoltaic power plant.


## KEYWORDS

photovoltaic penetration, photovoltaic, load flow study, wind farm, renewable energy, clean energy, solar

## 1 Introduction

Electricity generation has produced significant greenhouse gas emissions since the Industrial Revolution. Recently, there has been a global push to convert to sustainable and ecologically friendly energy technologies. For the energy industry to have a sustainable future, it is essential to integrate renewable energy sources into organised environments, such as solar systems. As a result, photovoltaic systems have seen a sharp surge in their use recently (Lampropoulos et al., 2020; Laowanitwattana and Uatrongjit, 2020; Lin, 2022; Stecanella et al., 2020). Global energy demand is expected to rise by more than 30% by 2040, according to the International Energy Agency (Vainio et al., 2020). Emerging nations are now adopting integrated resource planning to increase renewable energy generation. Consequently, the need for the installation of distributed generation (DG) systems to the network is anticipated to proliferate (Elavarasan, 2019; Kumar et al., 2020; Raju et al., 2020; Noorollahi et al., 2021). The reliance on the distribution, as mentioned previously, infrastructure cost, yearly energy losses, and carbon emissions are all decreased by distributed photovoltaic power systems (Kumar et al., 2020).

The power supply system (EDS) can manage and meet the growing demand for load by integrating distributed power generation. Distributed output sources like a photovoltaic system and electric charges are combined with EDS's energy-saving system (ESS) (Jinfeng et al., 2016;

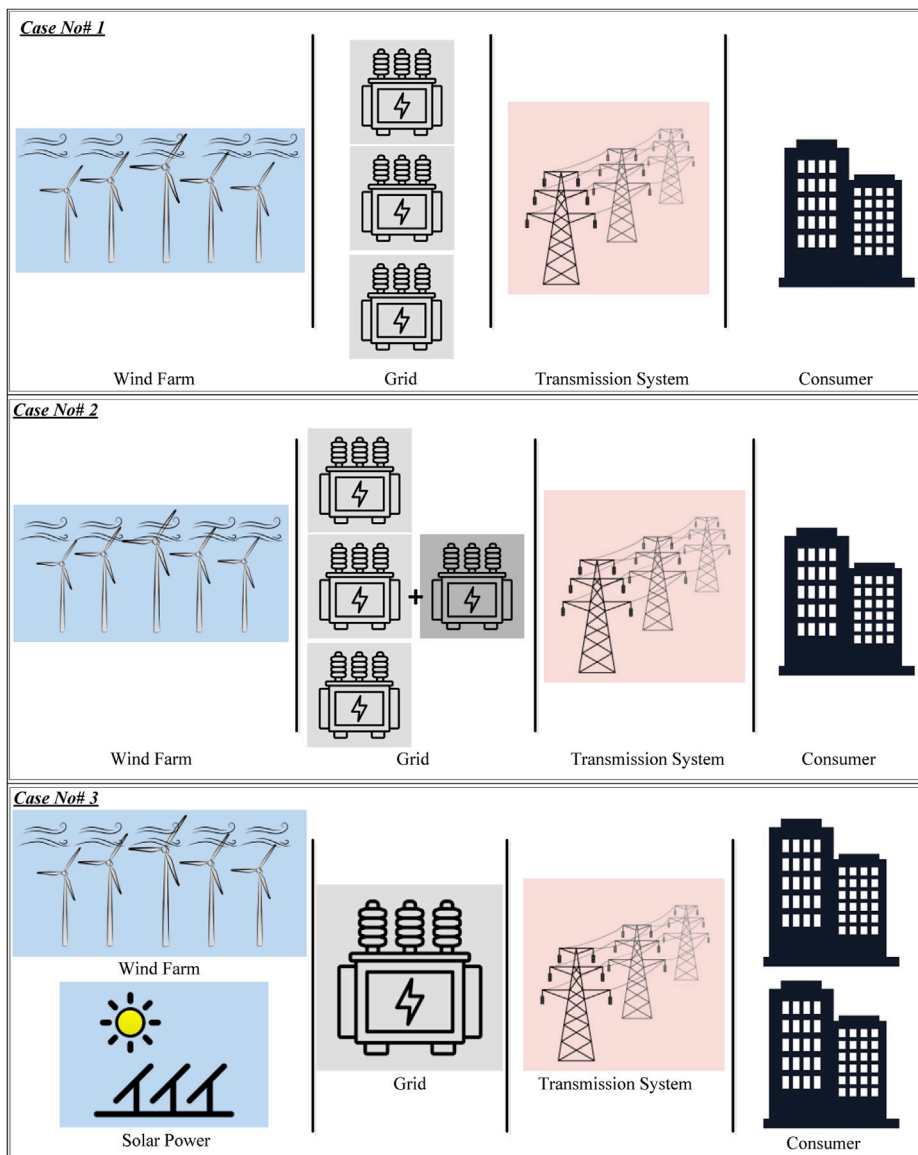

**FIGURE 1**  
Abstractable representation of the paper.

Elavarasan et al., 2019; Elavarasan et al., 2020; Madurai Elavarasan et al., 2020). There are extensive research studies on sustainable energy production and management. National state policies on energy, renewable energy sources (linked to the grid or individual), and the development of renewable energy production systems, such as small hydropower, photovoltaic energy, wind power, geothermal energy, and wave energy, are implemented in different countries (Tamoore et al., 2020; Schöniger et al., 2021). Individual microgrids should be optimised to minimise energy production costs and the environmental impact (Ostovar et al., 2021). An economical and clean method to electrify remote areas is covered by analysing and comparing extending primary grid and distribution generation.

One such option is solar radiation which is easily accessible and does not suffer from intermittent supply or availability. The other option would be an efficient energy management algorithm to ensure

minimal energy usage whilst satisfying a load demand. However, with fewer resources available, renewable energy will be more expensive (Louy et al., 2017; Hamoud et al., 2021; Hoang et al., 2022; Le et al., 2022; Miao et al., 2022).

To increase efficiency, intermittent renewable energy sources can be combined. A hybrid system will use one or a combination of renewable technologies to generate and store electricity. The benefit of this system is that autonomy is guaranteed with a multi-source approach to generating electricity. Multiple research papers have documented different systems which combine various sources of solar generators, wind generators, and storage systems to create a hybrid standby system. We can apply a technique to make the most out of limited resources. One crucial aspect is ensuring that energy is used wisely and intelligent decisions are made (Louy et al., 2017; Li et al., 2022; Wang et al., 2022; Shang et al., 2023; Wang et al., 2023).

TABLE 1 Details of the wind farm capability.

Name of WTG	Rated capacity (MW)	Opt. limit (MW)	Amp loading	% generation
ARTISTIC	50	50	218.7	100
MASTER	49.5	49.5	216.5	100
Metro	60	60	262.4	100
Sachal	49.5	49.5	216.5	100
Tricon Boston A	50	50	218.7	100
Tricon Boston C	50	50	218.7	100
TGS	50	50	218.7	100
TGT	50	50	218.7	100
UEP	99	99	433	100
ZEPHYR	50	50	218.7	100

This study aims to scrutinise the penetration of solar energy in wind farms. PV penetration can considerably reduce reliance on finite and environmentally destructive fossil fuels. This integration can also assist in reducing carbon emissions, a significant source of climate change. Furthermore, combining solar and wind energy helps compensate for the intermittent nature of wind farms, as the two renewable energy sources complement each other. Finally, this integration can increase the system's power capacity, improving efficiency and cost savings in the long run. Overall, solar energy penetration in wind farms and the national grid has the potential to revolutionise the energy landscape and pave the way for a more sustainable future.

As the increase in the load with the growth and dependency on the power in increasing the loading of the equipment such as transformers, buses, and other protective devices is raised from the permissible level, to continue the safe operation of the associated equipment and meet the future expansion and need of power, the load flow is needed. In this paper, we have added more energy from renewable sources to cater the power issues as well as maintain a good and healthy environment in developing countries like Pakistan, where economic problems are involved. Figure 1 shows the abstractable representation of this paper.

The remainder of the paper is organized as follows: Section 2 gives the literature review, including research methodology. In Section 3, the simulation models and the proposed block diagrams are discussed. Conclusion is reported in Section 4.

## 2 Literature review

In the new energy power system, two technical revolutions co-occur. The optimal operating method of interaction between supply and demand groups was established for power system planning, decision-making, and safe operation (Nwaigwe et al., 2019). Efficiency, safety, economy, and environmental benefits can be maximised by a harmonious interplay between supply and demand groups, which are interwoven (Hamoud et al., 2021). A two-layer optimum scheduling model was established, so that the intelligent industrial park could participate in system operation. Scheduling approaches for source-charge coordination were examined, and the active participation of the load was

TABLE 2 Details of the transformer power flow.


Transformer	Rating	Allowable	kW flow	kVAR
Auto T/F T-1 XIAN XD	132/ 220 kV	250 MVA	215473	-16466.1
Auto T/F T-2 XIAN XD	132/ 220 kV	250 MVA	215473	-16466.1
Auto T/F T-3 XIAN XD	132/ 220 kV	250 MVA	215473	-16466.1
Auxiliary load TF	132/11 kV	13000 kVA	25.5	15.81

implemented for the intelligent industrial park (Luty et al., 2023). Researchers studied wind farm power systems with fuzzy opportunity scheduling models to see if they could save energy, reduce pollutants, and improve overall system safety. The reliable and safe operation of a wind-integrated electrical grid is conducted using an HVDC system (Miao et al., 2022).

Due to the development in demand flexibility, the interplay between demand and the grid has been dramatically strengthened, but so has the risk during power system operations (Rokni Nakhi and Ahmadi Kamarposhti, 2020). Using probabilistic currents as a starting point for overcoming the shortcomings of the electrical grid is essential because of this unpredictability. The total electricity generation cost will be reduced by approximately a little less than one-third of the total cost of generation (Mirbarati et al., 2022). Grid performance is enhanced by the involvement of distributed generation in the national grid as shown in a case study of Saudi Arabia (Alqahtani and Patino-Echeverri, 2023). For power flow calculations, the authors combined semi-invariant and Gram-Charlier series expansions (Fu et al., 2020). This has been extensively studied (Nwaigwe et al., 2019). A stochastic configuration point technique for a probabilistic power flow algorithm was developed using uncertainty quantisation. The Monte Carlo approach was used as a reference value, and the analysis object was a wind and PV power generation system. A faulty condition related to the induction generator of a wind turbine was discussed to protect

TABLE 3 Power flow on buses.

Name of the bus	Rated kV	Type	Rating	MW	Amp
TMK CITY CKT-I	132	Power grid	30 MW	30	132.6
TMK CITY CKT-II	132	Power grid	60 MW	60	272
TMK Road CKT-I	220	Distribution grid	380 MVA	-323.2	850.7
TMK Road CKT-II	220	Distribution grid	375 MVA	-323.2	850.7

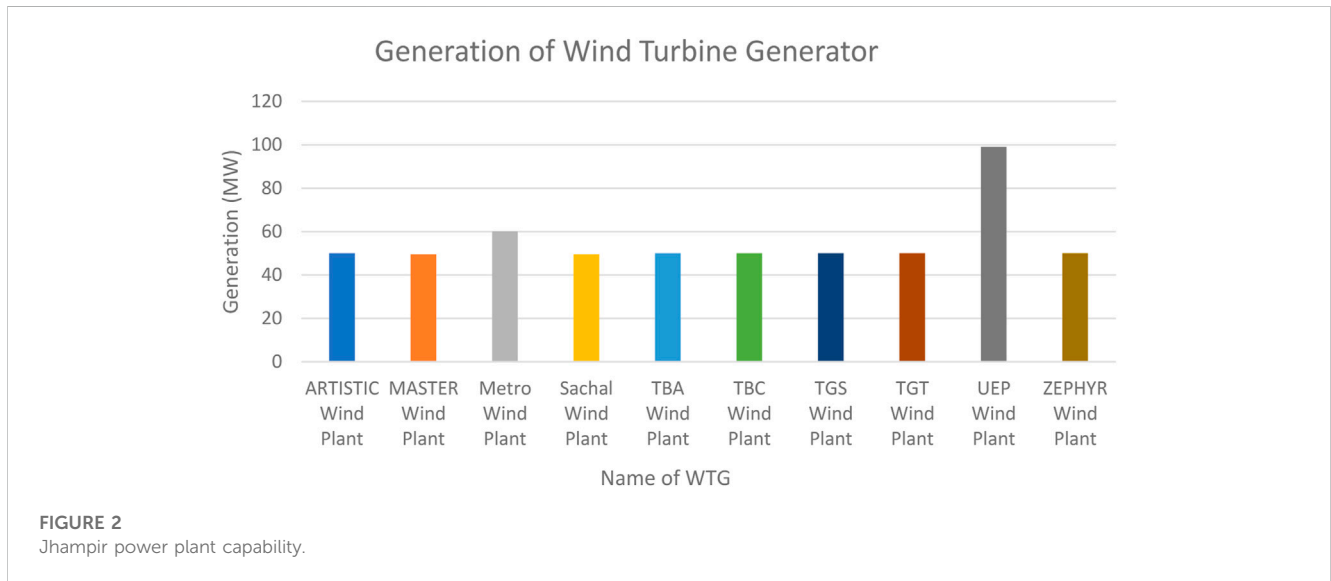

the plant (Ansari and Dyanamina, 2022). Several different potentials were tested to see how well the lower-invariant approach was computed accurately (Rebollal et al., 2021).

## 2.1 Power flow analysis

The bus in a power system is accompanied by the most significant phase angle of voltage, real, and reactive power. Three classes of buses are classified confidentially based on four dimensions, two of which are quantified and the remaining two can be derived from the comparison’s outcome (Al-Shetwi et al., 2020).

### 2.1.1 Load bus

However, the phase angle and bus voltage magnitude can be identified, and the active and reactive power of the load bus can be defined. Only the active and reactive components of a load bus that can be allowed to fluctuate the voltage by a permissible value, such as 5%, would need to be specified, as the voltage phase angle is insignificant.

### 2.1.2 Generator bus

The bus’s rated actual power and rated voltage are specified. The voltage phase angle and the reactive power cohort of the bus are two

critical metrics. At power generation stations, the generator bus is taken into consideration.

### 2.1.3 Swing bus

Identifying the voltage’s magnitude and phase angle in this bus is possible. However, the load flow resolution strongly influences the actual and reactive power. To compensate for transmission losses, the generator bus in this category underwrites the additional real and reactive power supply. For this bus is acknowledged as a swing bus (Soomar et al., 2021).

## 2.2 Load flow

Load flow is considered obligatory for planning, operating, and developing a system that exchanges power between utility divisions, as well as economic accelerations. Load flow investigation is used in stability under transients, optimal power flow, continuity or urgency studies, and load flow analysis. As a result of this increasing demand, not only will we need to build more generating stations, but we will also need to redesign and restructure the current power grids using advanced techniques, as well as the data on analysis of load flow, which are helpful to oversee degree and angle in phase between voltages at every bus with the reactive and real power

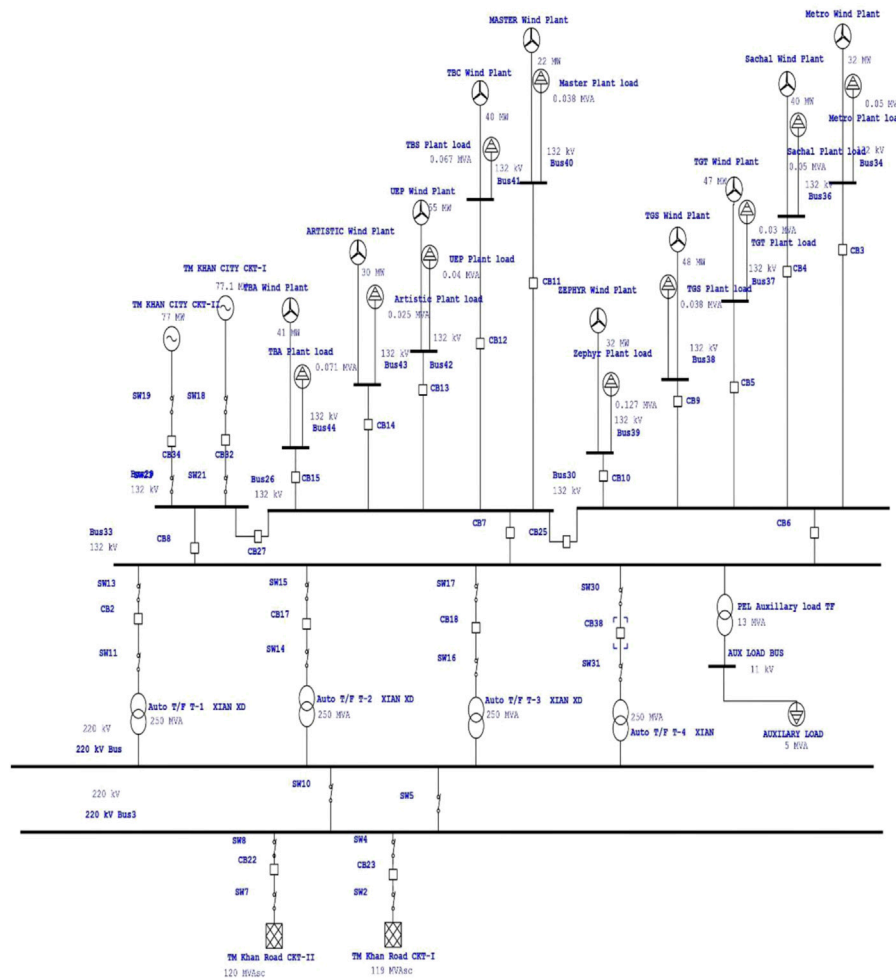


FIGURE 3 Grid enhancement through a single-line diagram.

TABLE 4 Details of the wind power capacity of power generation.

Name of WTG	Rated capacity (MW)	Opt. capacity (MW)	Amp loading	% generation
ARTISTIC	50 MW	50	218.7	100
MASTER	49.5 MW	49.5	216.5	100
Metro	60 MW	60	262.4	100
Sachal	49.5 MW	49.5	216.5	100
Tricon Boston A	50 MW	50	218.7	100
Tricon Boston C	50 MW	50	218.7	100
Three Gorges South	50 MW	50	218.7	100
Three Gorges Third	50 MW	50	218.7	100
United Energy Pakistan	99 MW	99	433	100
ZEPHYR	50 MW	50	218.7	100

TABLE 5 Power flow on transformers.

Transformer	Rating	kW flow	kVAR flow	Amp flow
Auto T/F T-1 XIAN XD	132/220 kV	160543	-10037.9	422.1
Auto T/F T-2 XIAN XD	132/220 kV	160543	-10037.9	422.1
Auto T/F T-3 XIAN XD	132/220 kV	160543	-10037.9	422.1
<b>Auto T/F T-4 XIAN XD</b>	<b>132/220 kV</b>	<b>160543</b>	<b>-10037.9</b>	<b>422.1</b>
PEL auxiliary load TF	132/11 kV	4221.7	2807.8	22.18

Bold represents additional transformer representation for particular case.

TABLE 6 Power flow on buses.

Bus name	Type	Rating	MW loading	Amp
TMK CITY CKT-I	Power grid	30 MW	30	131.9
TMK CITY CKT-II	Power grid	60 MW	60	267.3
TMK Road CKT-I	Distribution grid	380 MVA	-321.086	844.3
TMK Road CKT-II	Distribution grid	375 MVA	-321.086	844.3

consumptions in separate transmission lines through the implementation of electrical transient software (Mirbarati et al., 2022). The power flow was analysed, and the equation was derived using a rudimentary power system. The authors used iterative techniques like Newton–Raphson, Gauss–Seidel, and fast decoupled methods to solve these equations. The fast decoupled approach is a quicker and simplified form of the Newton–Raphson method. Solving overflow equations is much more reliable and faster than the Newton–Raphson method (Li et al., 2022).

The contribution of the life cycle of hybrid renewable energy sources energised by solar and wind power is assessed in the sustainable development background for the energy systems (Piotrowska et al., 2022). It was determined that the 138/69 kV grid station's power flow analysis and the load flow analysis results could improve a variety of performances by applying various approaches to power factor rectification that result in several technical and economic benefits. Improved voltage stability and loss of power, with minimal equipment loading and reorganisation of heavy costs, can be achieved using these strategies. They used the Electrical Transient Analysis Program to create a one-line diagram of the substation. They then analysed various aspects of the substation, including the loss of generators, a transmission line, a transformer, and a load. The optimal size and area of a capacitor bank were determined to overcome the problem of under-voltage (Wang et al., 2022). The autoregulated model of the 220/132 kV grid was developed in the study. Load flow analysis for the future expansion of the grid was successfully carried out in the paper. The simulation for various cases, such as the optimum load capacity with maximum generation, allows us to see the behaviour of the total capacity without any faults, and the system will remain intact. The loading of other generators was discussed under the total capacity. For future load addition and expansion of the grid, adding new circuits to extend its power included one transformer into the grid to increase its capacity from 750 to 1,250 MW. We suggest system reliability and save the operation and future expansion, so that

more power is delivered to the user end and the cheapest power from renewable sources can be injected into this grid. Simulations confirm the effectiveness of the proposed work.

### 2.2.1 Solar integration—benefits and challenges

Numerous other advantages of solar generation are available besides the enormous environmental benefits. The extensive climate change impact was studied in Togo the using solar-energy-powered smart grid (Amega et al., 2022). Furthermore, carbon emission is also reduced by using the photovoltaic generation method, along with a decrement in the cost of power generation (Xu et al., 2022). However, it comes with its own set of problems regarding grid integration. In light of the benefits and constraints, utilities must incorporate solar generation into their long-term planning processes and handle the grid integration challenges through appropriate means (Ansari and Dyanamina, 2022).

### 2.2.2 Benefits

- Diversification of fuels and energy sustainability.
- Cost stability due to no fuel costs: long-term price saving.
- Benefits and geographical distribution models.
- Partial correlations with reaching peak demand.


### 2.2.3 Challenges

- Uncertain output that fluctuates, especially during different weather conditions.
- Partial unpredictability.
- Unable to share solar energy with networks, such as frequency support.
- It supports reactive power and system inertia.
- Obstacles crossing the sides.
- Possibility of disabling it, as it is not subjected to the law ordering program (Mahmoud et al., 2021).

## 2.3 Technical standards for grid connectivity for solar generation

The balance between demand and supply is critical to a secure and reliable grid operation in the electricity system. A detailed advancement of computing techniques is covered while integrating intelligent renewable energy systems into the smart grid (Al-Shafei et al., 2022). There is a frequency deviation if there is a mismatch. Additionally, voltage fluctuations can be caused by reactive power imbalances. Load following is required



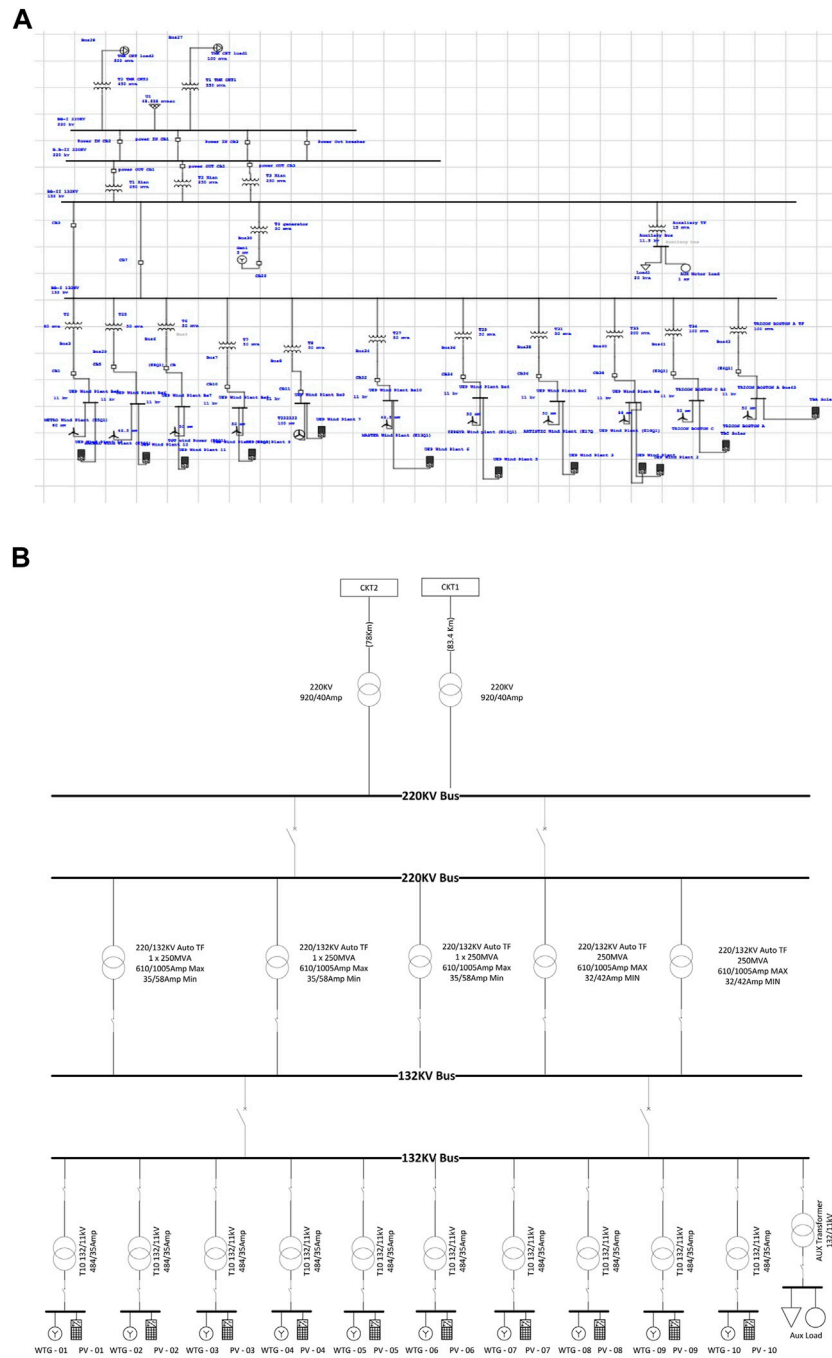

**FIGURE 4**  
(A, B) One-line diagram of the proposed PV power penetration.

to keep the system frequency within target bands to keep the power system operation safe. Reactive power management is also critical to ensuring safe grid voltages and, thus, a reliable grid operation. Supplying imbalances in the system to keep the frequency and voltage under defined targets is often carried out by conventional plants referred to as dispatchable units. Demand-side management (DSM) may also address these imbalances. A characteristic of renewable energy sources (such as wind and solar) is that they are known as variable generators (VGs) (Rebollar et al., 2021).

Because VGs can only sometimes be generated on demand, they need to be dispatchable by design. It was previously thought that they would only participate in grid support or leave a minor influence on the grid through non-compliance because of technological limitations. However, if renewable energy sources become more prevalent, VGs, such as solar generators, will be expected to carry out more than offering grid support. In that case, they will also be expected to overcome their limits, such as compliance with fault ride-through, which could negatively affect them. Advanced inverter systems, which

TABLE 7 Details of the enhanced grid after PV penetration.

Hybrid power	Generation capacity	Installed capacity (MW)	% generation
ARTISTIC Wind Bus	50	50	100
ARTISTIC SOLAR BUS	44.372	50	88.744
MASTER Wind Bus	49.5	49.5	100
MASTER SOLAR	44.372	49.5	88.744
Metro Wind Bus	60	60	100
Metro SOLAR	51.653	60	86.088
Sachal Wind Bus	49.5	49.5	100
Sachal SOLAR	44.372	49.5	88.744
TGS Wind Bus	50	50	100
TGS SOLAR	44.372	50	88.744
TGT Wind Bus	50	50	100
TGT SOLAR	44.372	50	88.744
UEP Bus	100	100	100
UEP SOLAR BUS	88.743	100	88.743
ZEPHYR Bus	50	50	100
ZEPHYR SOLAR	44.372	50	88.744
Tricon Boston A Bus	50	50	100
Tricon Boston A SOLAR	44.372	50	88.744
Tricon Boston C Bua	50	50	100
Tricon Boston C SOLAR	44.372	50	88.744


TABLE 8 Wind bus power flow.

Terminal bus	Rating (MW)	MW	MVAR	Amp	% PF	% generation
ARTISTIC Wind Bus	50	50	30.987	2955	85	100
MASTER Wind Bus	49.5	49.5	30.677	2927	85	100
Metro Wind Bus	60	60	29	3116	90	100
Sachal Wind Bus	49.5	49.5	27	2579	90	100
Tricon Boston A Bus	50	50	30.987	2955	85	100
TGS Wind Plant Bus	50	50	30.987	2955	85	100
TGT Wind Plant Bus	50	50	30.987	2975	85	100
Tricon Boston Bua	50	50	30.987	2955	85	100
UEP Bus	100	100	61.974	5950	85	100
ZEPHYR Bus	50	50	30.987	2955	85	100

have recently made significant technological advances due to their advanced design, can already provide grid support capabilities, such as active power reduction, fault ride-through (FRT), and voltage support; however, these capabilities currently need to be improved. Expanded inverters are not a new form of inverters but instead require only

minor software upgrades or operational parameters to enable them to advanced stages (Allouhi et al., 2019; Al-Shetwi et al., 2020). Inverters' ability to offer uninterruptible service during disruptions is demonstrated by fault ride-through on low/high-voltage ride-through compliances. Excessive DC-link voltages, excessive AC,



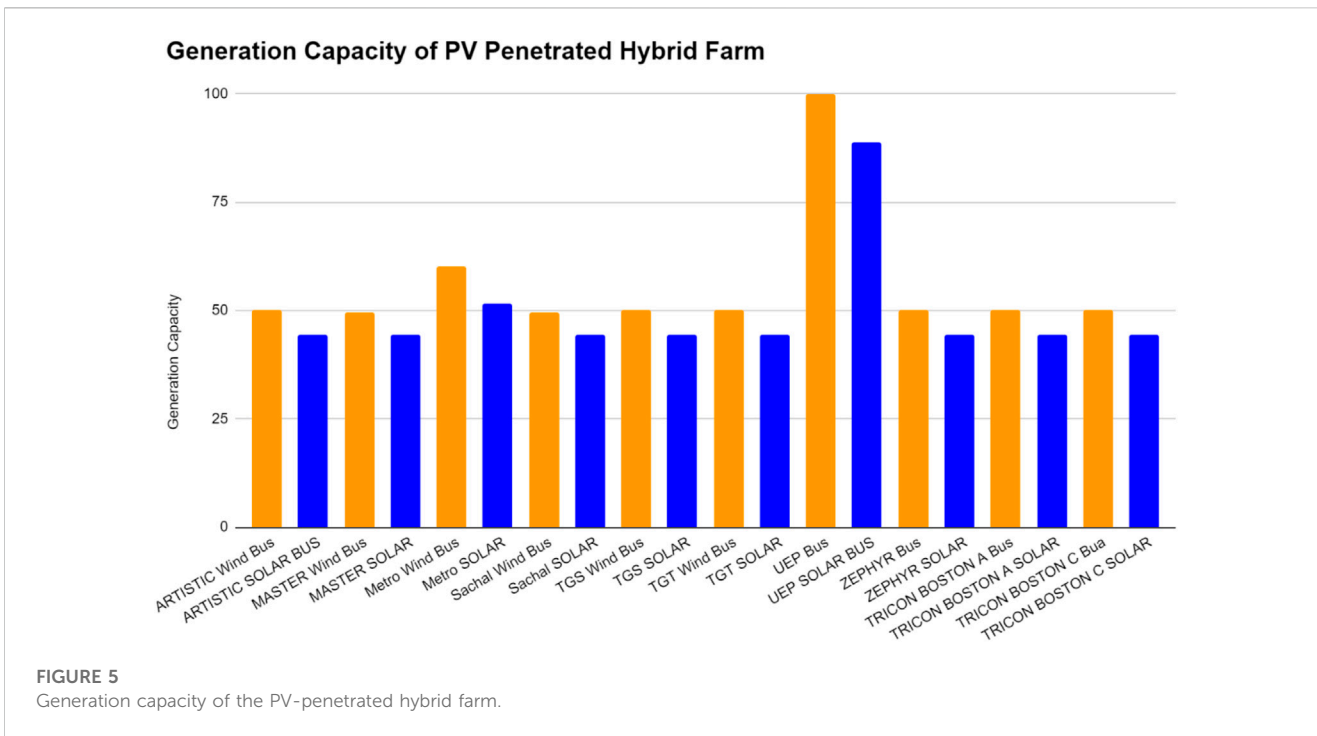

and loss synchronisation are common causes of inverter disconnection in the aforementioned situations. If an inverter’s solid-state device (IGBT/GTO) current rating exceeds the grid’s maximum AC, the inverter is unplugged from the grid. A voltage sag in the grid causes a rise in the current because the voltage drops on the grid side (Louy et al., 2017; Liu et al., 2020; Mahmoud et al., 2021; Reddy et al., 2021).

An over-current protection mechanism is activated, removing the inverter from the grid. The DC-link capacitor voltage increases when the power generated in the grid-connected PV plant’s DC side exceeds the capacity fuelled into the grid. As previously stated, the inverter must resist such a rise in the DC-link voltage. The plant must, therefore, be safeguarded under fault conditions because the generated power cannot be reduced.

### 2.4 In most cases, grid synchronisation is accomplished using a traditional phase-locked loop method

The standard phase-locked loop (PLL) arrangement fails miserably in asymmetrical fault situations, and the inverter is unplugged from the grid. Because of their rising penetration and equal treatment with conventional generation, solid-state and photovoltaic generators have evolved with four operational grids. Various grid codes for a solar generator can be analysed in light of the global standards. Few global standards have been found to address the PV grid connectivity requirements at EHV for such inverter-based solar generation systems, as the majority of the global solar generation capacity is connected at the MV/LV (distribution) level as opposed to the EHV level (Amega et al., 2022; Xu et al., 2022).

## 2.5 Research methodology

A detailed study was conducted on the ETAP platform. A comprehensive case study was performed on the 220/132 kV Jhampir grid by developing a one-line diagram. Power flow analysis was conducted by analysing the flow of losses and the load on individual buses. Relevant data were collected from the 220/132 kV Jhampir grid. First, the addition of an autotransformer was considered to observe the feasibility. Finally, the grid was penetrated with PV power, and the results were obtained after analysing these conditions on the ETAP platform.

## 3 Cases for the load flow analysis

In this paper, we discuss three cases for the load flow analysis, which are provided in the following sections.

### 3.1 Case 1: Jhampir wind turbine power station operating at the peak

An optimum condition was considered to observe the Jhampir power station. Each plant operated at its highest possible capacity under normal and steady-state conditions, as depicted in Table 1. The power flow of 132 kV/220 kV is displayed in Table 2 based on the requirements shown in Table 1, while the power flow from generation to the consumer’s side is shown in Table 3.

The potential of power generation of various power plants in the wind farm of Jhampir is described in Figure 2. As shown in the figure, multiple wind power plants were installed at the wind farm of Jhampir, Pakistan. Most plant generation was rated at

TABLE 9 Power flow at the bus after addition of solar.

Bus ID	Type	Generation	Amp loading	% generation
ARTISTIC SOLAR BUS	Solar	44.372	2229	88.744
MASTER SOLAR	Solar	44.372	2230	88.744
Metro SOLAR	Solar	51.653	2682	86.088
Sachal SOLAR	Solar	44.372	2312	88.744
TGS SOLAR	Solar	44.372	2229	88.744
TGT SOLAR	Solar	44.372	2244	88.744
Tricon Boston A SOLAR	Solar	44.372	2229	88.744
Tricon Boston C SOLAR	Solar	44.372	2229	88.744
UEP SOLAR BUS	Solar	88.743	4488	88.743
ZEPHYR SOLAR	Solar	44.372	2229	88.744

50 MW, while UEP showed the highest generation in the wind farm.

### 3.2 Case 2: wind farms respond after the expansion or addition of autotransformers in the grid

In this case, adding one autotransformer was considered to enhance the grid's capacity. The grid enhancement was supposed to deliver additional power to a small city Tando Muhammad Khan. This city is almost three-fourth of 100 km from the existing grid station and comprises two circuits. Figure 3 displays the Jhampir power station's one-line diagram after the autotransformer's addition. This one-line diagram consists of the entire setup of the feeder, along with its protection schemes. This single-line diagram comprises all of the plants in Figure 2.

The results showed that each power plant in the Jhampir wind farm operates at its maximum capability. It showed that additional power is drawn from the TMK circuit (depicted as TMK City I and TMK City II). The details of the power flow are shown in Table 4. The power contribution of the individual plant is displayed in Table 5. Table 6 shows the transformer loading capability, and bus loading capability is shown in Table 6.

### 3.3 Case 3: penetration of PV power in the existing wind farm of Jhampir

In this case, the penetration of PV power in existing wind farms is discussed. The proposed single-line diagram is displayed in Figures 4A, B. Figure 4A contains the layout of the extension of the existing power capacity of the wind farm in Jhampir. This figure was generated using ETAP software to analyse and simulate PV penetration in the wind farm. PV power enhances the reliability of the existing Jhampir wind power station. Figure 4B provides a more precise concept of the proposed scheme, highlighting the location of PV penetration in the wind farm. The renewable mix was integrated at 132 kV and transmitted into two primary circuits rated at 220 kV.

Table 7 represents the details after adding the PV panel power station. In contrast, Table 8 describes the data of the reserves of the transformer, and the bus power flow is shown in Tables 7, 8. Figure 5 comprehensively illustrates the generation capacity of PV-penetrated mixed farms. The figure describes the detailed MW power generated as a graphical representation by the individual plant listed in Figures 4A, B. Table 9 shows the power flow at the bus after the integration of the solar in the Grid.

## 4 Conclusion

In this study, the potential is explored by penetrating the PV power in the existing wind farm of Jhampir, Pakistan. Conclusively, case 1 details the installed power capacity of the wind farm. In case 2, adding an autotransformer raises the installed capacity of the wind farm to 1,250 MW (1.66 times the original total). In case 3, PV penetration enhances the wind farm supply system, increasing the installed capacity to 1,540 MW (1.23 times the previous value). The results describe the power flow analysis and explore the feasibility of PV penetration of the Jhampir power station. Conclusively, fossil fuel dependency is reduced as a renewable energy mix is utilised instead. This is highly desirable for developing countries like Pakistan, as it is struggling from extreme power, economic crisis, and fuel crisis.

## Data availability statement

The original contributions presented in the study are included in the article/Supplementary Material; further inquiries can be directed to the corresponding author.

## Author contributions

All authors listed have made a substantial, direct, and intellectual contribution to the work and approved it for publication.

## Acknowledgments

All authors have helped with the completion of this paper, and we would like to express our gratitude to Power China Huadong Engineering Co., Ltd., Hangzhou, China, for their assistance in data collection, and last but not least, thanks to the Faculty of Electrical and Control Engineering, Gdańsk University of Technology, Poland, for providing online library resources.

## Conflict of interest

LG was employed by Power China Huadong Engineering Co., Ltd.

## References

- Al-Shafei, A., Zareipour, H., and Cao, Y. (2022). High-performance and parallel computing techniques review: Applications, challenges and potentials to support net-zero transition of future grids. *Energies (Basel)* 15 (22), 8668. doi:10.3390/en15228668
- Al-Shetwi, A. Q., Hannan, M. A., Jern, K. P., Mansur, M., and Mahlia, T. M. I. (2020). Grid-connected renewable energy sources: Review of the recent integration requirements and control methods. *J. Clean. Prod.* 253, 119831. doi:10.1016/j.jclepro.2019.119831
- Allouhi, A., Saadani, R., Buker, M. S., Kousksou, T., Jamil, A., and Rahmoune, M. (2019). Energetic, economic and environmental (3E) analyses and LCOE estimation of three technologies of PV grid-connected systems under different climates. *Sol. Energy* 178, 25–36. doi:10.1016/j.solener.2018.11.060
- Alqahtani, B. J., and Patino-Echeverri, D. (2023). Identifying economic and clean strategies to provide electricity in remote rural areas: Main-grid extension vs. Distributed electricity generation. *Energies (Basel)* 16 (2), 958. doi:10.3390/en16020958
- Amega, K., Laré, Y., Bhandari, R., Moumouni, Y., Egbendewe, A., Sawadogo, W., et al. (2022). Solar energy powered decentralized smart-grid for sustainable energy supply in low-income countries: Analysis considering climate change influences in Togo. *Energies (Basel)* 15 (24), 9532. doi:10.3390/en15249532
- Ansari, A. A., and Dyanamina, G. (2022). Fault Ride-Through operation analysis of doubly fed induction generator-based wind energy conversion systems: A comparative review. *Energies (Basel)* 15 (21), 8026. doi:10.3390/en15218026
- Elavarasan, R., Shafiullah, G., Manoj Kumar, N., and Padmanaban, S. (2019). A state-of-the-art review on the drive of renewables in Gujarat, state of India: Present situation, barriers and future initiatives. *Energies (Basel)* 13 (1), 40. doi:10.3390/en13010040
- Elavarasan, R. M., Shafiullah, G. M., Padmanaban, S., Kumar, N. M., Annam, A., Vetrichelvan, A. M., et al. (2020). A comprehensive review on renewable energy development, challenges, and policies of leading Indian states with an international perspective. *IEEE Access* 8, 74432–74457. doi:10.1109/access.2020.2988011
- Elavarasan, R. M. (2019). The motivation for renewable energy and its comparison with other energy sources: A review. *Eur. J. Sustain. Dev. Res.* 3 (1). doi:10.20897/ejodsr/4005
- Fu, X., Guo, Q., and Sun, H. (2020). Statistical machine learning model for stochastic optimal planning of distribution networks considering a dynamic correlation and dimension reduction. *IEEE Trans. Smart Grid* 11 (4), 2904–2917. doi:10.1109/tsg.2020.2974021
- Hamoud, G., el Nahas, I., and Faried, S. O. (2021). Reliability comparison of two deterministic criteria for planning high voltage auto-transformer stations. *IEEE Trans. Power Deliv.* 36 (4), 2056–2065. doi:10.1109/tpwr.2020.3018938
- Hoang, T. T., Tuan Tran, Q., Le, H. S., Nhan Nguyen, H., and Duong, M. Q. (2022). “Impacts of high solar inverter integration on performance of FLIRS function: Case study for Danang distribution network,” in Proceedings of the 2022 11th International Conference on Control, Automation and Information Sciences (ICCAIS), Hanoi, Vietnam, November 2022 (IEEE), 327–332.
- Jinfeng, W., Chunxiu, Y., Fang, L., Xufei, M., Jiangbo, W., and Junhui, L. (2016). “The development and utilisation of new clean energy,” in Proceedings of the 2016 IEEE International Conference on Power and Renewable Energy (ICPRE), Shanghai, China, October 2016 (IEEE), 639–643.
- Kumar, N. M., Chopra, S. S., Chand, A. A., Elavarasan, R. M., and Shafiullah, G. M. (2020). Hybrid renewable energy microgrid for a residential community: A techno-economic and environmental perspective in the context of the SDG7. *Sustainability* 12 (10), 3944. doi:10.3390/su12103944
- Lampropoulos, I., Alskaf, T., Schram, W., Bontekoe, E., Coccato, S., and van Sark, W. (2020). Review of energy in the built environment. *Smart Cities* 3 (2), 248–288. doi:10.3390/smartcities3020015
- Laowanitwattana, J., and Uatrongjit, S. (2020). Probabilistic power flow analysis based on arbitrary polynomial chaos expansion of bus voltage phasor. *Int. Trans. Electr. Energy Syst.* 30 (5). doi:10.1002/2050-7038.12315
- Le, X. C., Duong, M. Q., and Le, K. H. (2022). Review of the modern maximum power tracking algorithms for permanent magnet synchronous generator of wind power conversion systems. *Energies (Basel)* 16 (1), 402. doi:10.3390/en16010402
- Li, M., Yang, M., Yu, Y., and Lee, W. J. (2022). A wind speed correction method based on modified hidden markov model for enhancing wind power forecast. *IEEE Trans. Appl. Syst.* 58 (1), 656–666. doi:10.1109/tia.2021.3127145
- Lin, C. H. (2022). The impact of integration of the VSC-HVDC connected offshore wind farm on torsional vibrations of steam turbine generators. *Sustainability* 15 (1), 197. doi:10.3390/su15010197
- Liu, Z., Wang, D., Wang, J., Wang, X., and Li, H. (2020). A blockchain-enabled secure power trading mechanism for smart grid employing wireless networks. *IEEE Access* 8, 177745–177756. doi:10.1109/access.2020.3027192
- Louy, M., Tareq, Q., Al-Jufout, S., Alsafafseh, Q., and Wang, C. (2017). “Effect of dust on the 1-MW photovoltaic power plant at Tafila Technical University,” in Proceedings of the 2017 8th International Renewable Energy Congress (IREC), Amman, Jordan, March 2017 (IEEE), 1–4.
- Luty, L., Ziolo, M., Knapik, W., Bąk, I., and Kukula, K. (2023). Energy security in light of sustainable development goals. *Energies (Basel)* 16 (3), 1390. doi:10.3390/en16031390
- Madurai Elavarasan, R., Selvamanothar, L., Raju, K., Rajan Vijayaraghavan, R., Subburaj, R., Nurunnabi, M., et al. (2020). A holistic review of the present and future drivers of the renewable energy mix in Maharashtra, state of India. *Sustainability* 12 (16), 6596. doi:10.3390/su12166596
- Mahmoud, A. M., Ezzat, M., Abdelaziz, A. Y., and Aleem, S. H. E. A. (2021). “A cost-benefit analysis of optimal active and reactive power compensators and voltage conditioners allocation in a real Egyptian distribution system,” in Proceedings of the 2021 22nd International Middle East Power Systems Conference (MEPCON), Assiut, Egypt, December 2021 (IEEE), 116–123.
- Miao, Z., Meng, X., and Liu, L. (2022). Analyzing and optimizing the power generation performance of thermoelectric generators based on an industrial environment. *J. Power Sources* 541, 231699. doi:10.1016/j.jpowsour.2022.231699
- Mirbarati, S. H., Heidari, N., Nikoofard, A., Danish, M. S. S., and Khosravy, M. (2022). Techno-economic-environmental energy management of a micro-grid: A mixed-integer linear programming approach. *Sustainability* 14 (22), 15036. doi:10.3390/su142215036
- Noorollahi, Y., Kalantari, A. S., Saifoddin, A., and Yousefi, H. (2021). Distributed wind and solar power for grid sustainability and emission reduction. *Environ. Prog. Sustain. Energy* 40 (6), 40. doi:10.1002/ep.13686
- Nwaigwe, K. N., Mutabilwa, P., and Dintwa, E. (2019). An overview of solar power (PV systems) integration into electricity grids. *Mater. Sci. Energy Technol.* 2 (3), 629–633. doi:10.1016/j.mset.2019.07.002
- Ostovar, S., Esmaili-Nezhad, A., Moeini-Aghtaie, M., and Fotuhi-Firuzabad, M. (2021). Reliability assessment of distribution system with the integration of photovoltaic and energy storage systems. *Sustain. Energy, Grids Netw.* 28, 100554. doi:10.1016/j.segan.2021.100554

- Piotrowska, K., Piasecka, I., Klos, Z., Marczuk, A., and Kasner, R. (2022). Assessment of the life cycle of a wind and photovoltaic power plant in the context of sustainable development of energy systems. *Materials* 15 (21), 7778. doi:10.3390/ma15217778
- Raju, K., Madurai Elavarasan, R., and Mihet-Popa, L. (2020). An assessment of onshore and offshore wind energy potential in India using moth flame optimization. *Energies (Basel)* 13 (12), 3063. doi:10.3390/en13123063
- Rebollal, D., Carpintero-Rentería, M., Santos-Martín, D., and Chinchilla, M. (2021). Microgrid and distributed energy resources standards and guidelines review: Grid connection and operation technical requirements. *Energies (Basel)* 14 (3), 523. doi:10.3390/en14030523
- Reddy, G. R., Rayaguru, N. K., Karthikumar, K., Chandrasekar, P., and Murthy, P. (2021). "Enhancement of power quality with fuzzy based UPQC in grid integrated and battery assisted PV system," in Proceedings of the 2021 2nd Global Conference for Advancement in Technology (GCAT), Bangalore, India, October 2021 (IEEE), 1–8.
- Rokni Nakhi, P., and Ahmadi Kamarposhti, M. (2020). Multi objective design of type II fuzzy based power system stabilizer for power system with wind farm turbine considering uncertainty. *Int. Trans. Electr. Energy Syst.* 30 (4), 30. doi:10.1002/2050-7038.12285
- Schöniger, F., Thonig, R., Resch, G., and Lilliestam, J. (2021). Making the sun shine at night: Comparing the cost of dispatchable concentrating solar power and photovoltaics with storage. *Energy Sources, Part B Econ. Plan. Policy* 16 (1), 55–74. doi:10.1080/15567249.2020.1843565
- Shang, Y., Zhu, L., Qian, F., and Xie, Y. (2023). Role of green finance in renewable energy development in the tourism sector. *Renew. Energy* 206, 890–896. doi:10.1016/j.renene.2023.02.124
- Soomar, A. M., Shaikh, A. H., and Lashari, M. H. (2021). Power flow analysis of doubly fed induction generator based 220/132kv power grid. *Int. J. Electr. Eng. Technol.* 12 (9). doi:10.34218/ijeet.12.9.2021.010
- Stecanella, P. A. J., Vieira, D., Vasconcelos, M. V. L., and Ferreira Filho, A. D. L. (2020). Statistical analysis of photovoltaic distributed generation penetration impacts on a utility containing hundreds of feeders. *IEEE Access* 8, 175009–175019. doi:10.1109/access.2020.3024115
- Tamoor, M., Tahir, M. S., Sagir, M., Tahir, M. B., Iqbal, S., and Nawaz, T. (2020). Design of 3 kW integrated power generation system from solar and biogas. *Int. J. Hydrogen Energy* 45 (23), 12711–12720. doi:10.1016/j.ijhydene.2020.02.207
- Vainio, A., Pulkka, A., Paloniemi, R., Varho, V., and Tapio, P. (2020). Citizens' sustainable, future-oriented energy behaviours in energy transition. *J. Clean. Prod.* 245, 118801. doi:10.1016/j.jclepro.2019.118801
- Wang, P., Yu, P., Huang, L., and Zhang, Y. (2022). An integrated technical, economic, and environmental framework for evaluating the rooftop photovoltaic potential of old residential buildings. *J. Environ. Manage* 317, 115296. doi:10.1016/j.jenvman.2022.115296
- Wang, S., Wang, B., He, S., Wang, Y., Cheng, J., and Li, Y. (2023). Enhancing the photovoltaic performance of planar heterojunction perovskite solar cells via introducing binary-mixed organic electron transport layers. *New J. Chem.* 47 (10), 5048–5055. doi:10.1039/d2nj05127c
- Xu, W., Yu, B., Song, Q., Weng, L., Luo, M., and Zhang, F. (2022). Economic and low-carbon-oriented distribution network planning considering the uncertainties of photovoltaic generation and load demand to achieve their reliability. *Energies (Basel)* 15 (24), 9639. doi:10.3390/en15249639