



OPEN ACCESS

APPROVED BY
Frontiers Editorial Office,
Frontiers Media SA, Switzerland

*CORRESPONDENCE
Longfu Jiang
✉ longfujianghwamei@163.com

RECEIVED 24 October 2023
ACCEPTED 07 November 2023
PUBLISHED 29 November 2023

CITATION
Zheng N, Jiang L, Shen J and Zhong J (2023)
Corrigendum: Guidance on left bundle branch
pacing using continuous pacing technique and
changes in lead V1 characteristics under
real-time monitoring.
Front. Cardiovasc. Med. 10:1326956.
doi: 10.3389/fcvm.2023.1326956

COPYRIGHT
© 2023 Zheng, Jiang, Shen and Zhong. This is
an open-access article distributed under the
terms of the [Creative Commons Attribution
License \(CC BY\)](#). The use, distribution or
reproduction in other forums is permitted,
provided the original author(s) and the
copyright owner(s) are credited and that the
original publication in this journal is cited, in
accordance with accepted academic practice.
No use, distribution or reproduction is
permitted which does not comply with these
terms.

Corrigendum: Guidance on left bundle branch pacing using continuous pacing technique and changes in lead V1 characteristics under real-time monitoring

Nan Zheng, Longfu Jiang*, Jiabo Shen and Jinyan Zhong

Department of Cardiovascular Medicine, Ningbo NO.2 Hospital, Ningbo, China

KEYWORDS


left bundle branch pacing, left bundle branch capture, physiological pacing, left ventricular septal capture, electrocardiogram

A Corrigendum on
Guidance on left bundle branch pacing using continuous pacing technique and changes in lead V1 characteristics under real-time monitoring

By Zheng N, Jiang L, Shen J, Zhong J (2023). Front. Cardiovasc. Med. 10. doi: 10.3389/fcvm.2023.1195509

Error in Figure/Table

In the published article, there was an error in **Figure 4** as published. There are some confusing marks in the diagram. The corrected **Figure 4** and its caption appear below.

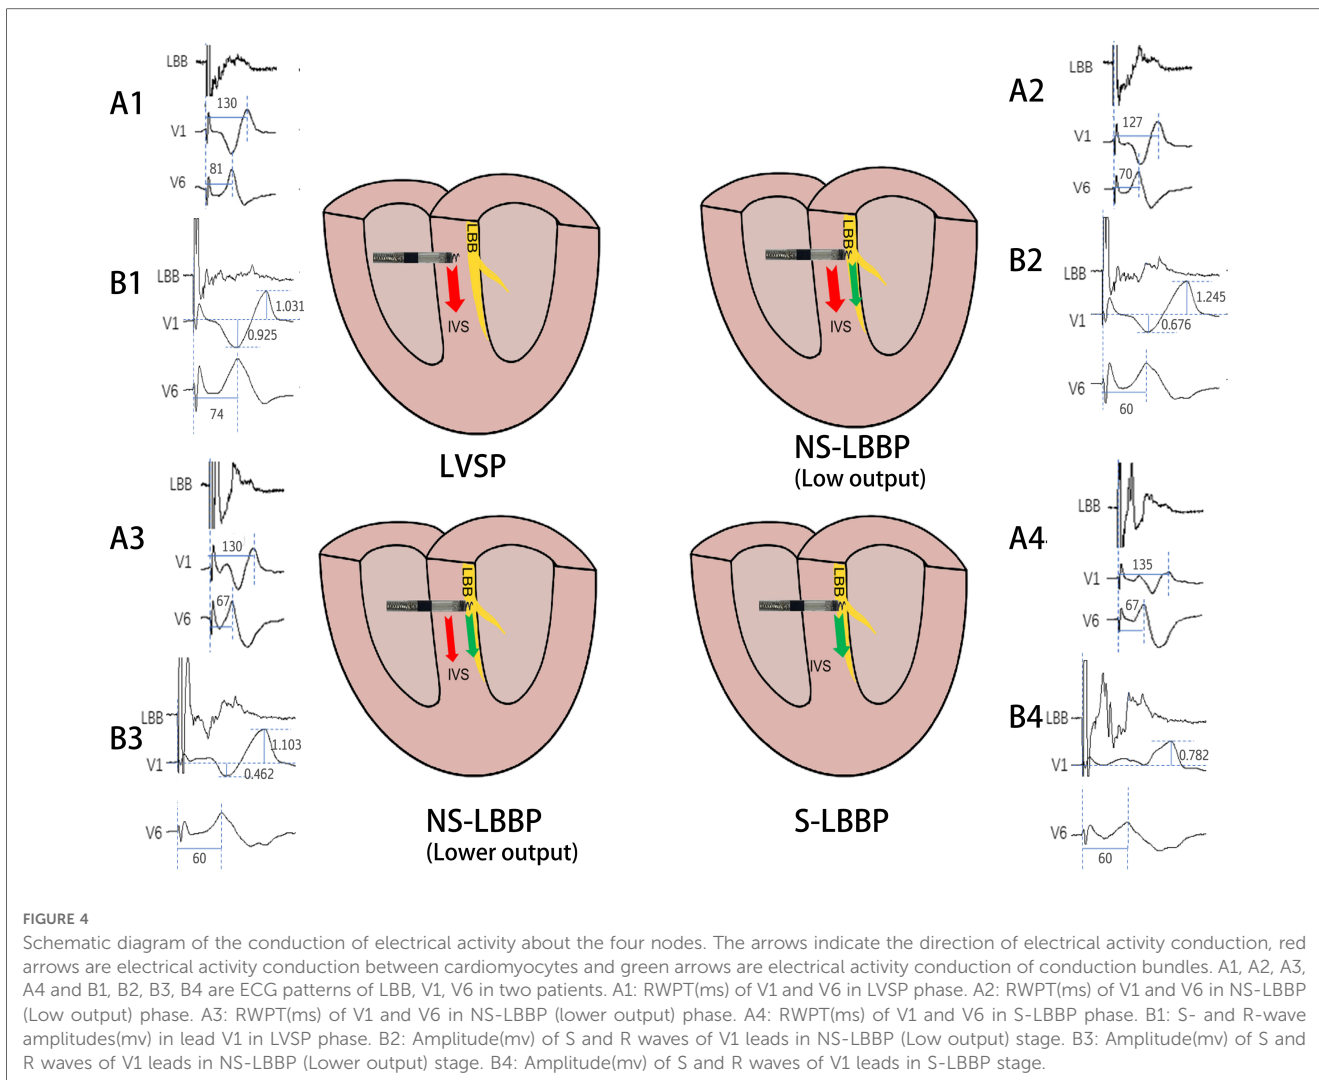

The authors apologize for this error and state that this does not change the scientific conclusions of the article in any way. The original article has been updated.

organizations, or those of the publisher, the editors and the reviewers. Any product that may be evaluated in this article, or claim that may be made by its manufacturer, is not guaranteed or endorsed by the publisher.

Publisher's note

All claims expressed in this article are solely those of the authors and do not necessarily represent those of their affiliated