



OPEN ACCESS

EDITED AND REVIEWED BY
Ping Yuan,
Tongji University, China

*CORRESPONDENCE

Dong-Jin Wang
✉ dongjin_wang@126.com
Qing Zhou
✉ zhouqing@njgly.com
Yong-Qing Cheng
✉ cyq197549@sina.com

[†]These authors have contributed equally to this work and share first authorship

SPECIALTY SECTION

This article was submitted to Inflammation, a section of the journal Frontiers in Immunology

RECEIVED 13 February 2023
ACCEPTED 21 February 2023
PUBLISHED 01 March 2023

CITATION

Pan T, Tuoerxun T, Chen X, Yang C-J, Jiang C-Y, Zhu Y-F, Li Z-S, Jiang X-Y, Zhang H-T, Zhang H, Wang Y-P, Chen W, Lu L-C, Ge M, Cheng Y-Q, Wang D-J and Zhou Q (2023) Corrigendum: The neutrophil elastase inhibitor, Sivelestat, attenuates acute lung injury in patients with cardiopulmonary bypass. *Front. Immunol.* 14:1165081. doi: 10.3389/fimmu.2023.1165081

COPYRIGHT

© 2023 Pan, Tuoerxun, Chen, Yang, Jiang, Zhu, Li, Jiang, Zhang, Wang, Chen, Lu, Ge, Cheng, Wang and Zhou. This is an open-access article distributed under the terms of the [Creative Commons Attribution License \(CC BY\)](https://creativecommons.org/licenses/by/4.0/). The use, distribution or reproduction in other forums is permitted, provided the original author(s) and the copyright owner(s) are credited and that the original publication in this journal is cited, in accordance with accepted academic practice. No use, distribution or reproduction is permitted which does not comply with these terms.

Corrigendum: The neutrophil elastase inhibitor, Sivelestat, attenuates acute lung injury in patients with cardiopulmonary bypass

Tuo Pan^{1,2†}, Tayierjiang Tuoerxun^{1†}, Xi Chen^{3†}, Cheng-Jin Yang⁴, Chen-Yu Jiang⁵, Yi-Fan Zhu⁵, Ze-Shi Li², Xin-Yi Jiang², Hai-Tao Zhang², He Zhang², Ya-Peng Wang², Wei Chen¹, Li-Chong Lu¹, Min Ge¹, Yong-Qing Cheng^{1*}, Dong-Jin Wang^{1,2*} and Qing Zhou^{1*}

¹Department of Cardio-Thoracic Surgery, Nanjing Drum Tower Hospital, Affiliated Drum Tower Hospital, Medical School of Nanjing University, Nanjing, China, ²Department of Cardio-Thoracic Surgery, Nanjing Drum Tower Hospital, Peking Union Medical College & Chinese Academy of Medical Sciences, Graduate School of Peking Union Medical College, Nanjing, China, ³The Jockey Club School of Public Health and Primary Care, The Chinese University of Hong Kong, Hong Kong, Hong Kong SAR, China, ⁴Department of Pediatric Surgery, Sanya Women and Children's Hospital, Sanya, China, ⁵Department of Cardio-Thoracic Surgery, Shanghai Children's Medical Center, School of Medicine, Shanghai Jiao Tong University, Shanghai, China

KEYWORDS

sivelestat, cardiopulmonary bypass, acute lung injury, cardiovascular surgery, outcomes

A Corrigendum on

The neutrophil elastase inhibitor, sivelestat, attenuates acute lung injury in patients with cardiopulmonary bypass

By Pan T, Tuoerxun T, Chen X, Yang C-J, Jiang C-Y, Zhu Y-F, Li Z-S, Jiang X-Y, Zhang H-T, Zhang H, Wang Y-P, Chen W, Lu L-C, Ge M, Cheng Y-Q, Wang D-J and Zhou Q (2023) *Front. Immunol.* 14:1082830. doi: 10.3389/fimmu.2023.1082830

In the published article, there was an error in **Figures 4B–D** as published. The blue lines were mistakenly identified as the Sivelestat group and the red lines were mistakenly identified as the Control group. The corrected Figure 4 and its caption “(A) The oxygen index (PaO₂/FiO₂), P<0.01; ※:P<0.05, †:P>0.05. (B) The procalcitonin, P<0.01; ※:P<0.05, †:P>0.05. (C) The interleukin-6, P=0.02; ※:P<0.05, †:P>0.05. (D) The C reactive protein, P<0.01; ※:P<0.05, †:P>0.05.” appear below.

The authors apologize for this error and state that this does not change the scientific conclusions of the article in any way. The original article has been updated.

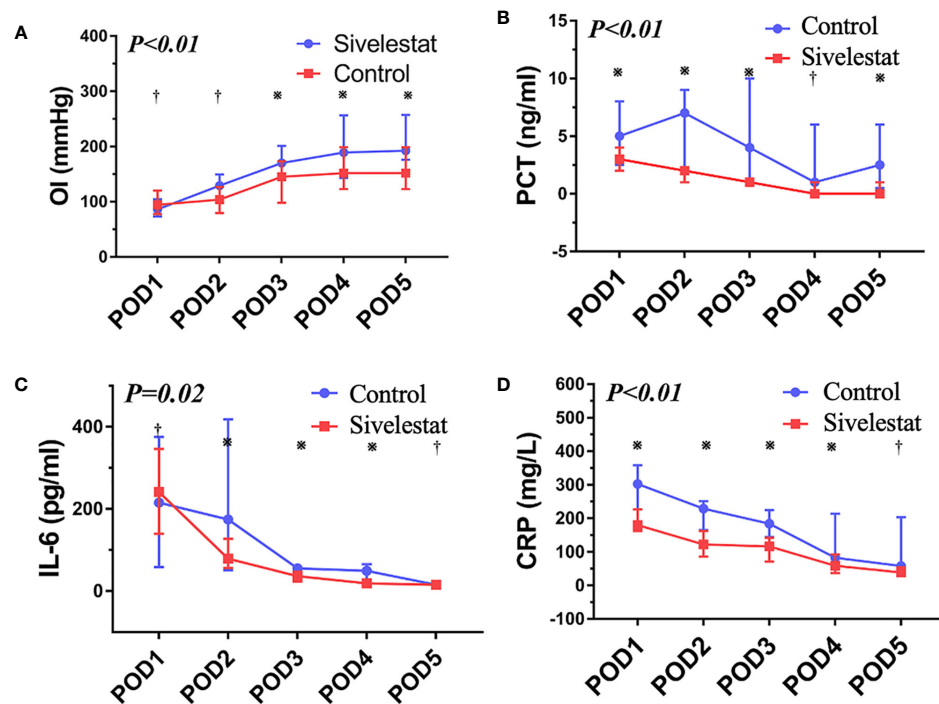


FIGURE 4

(A) The oxygen index ($\text{PaO}_2/\text{FiO}_2$), $P < 0.01$; ※: $P < 0.05$, †: $P > 0.05$. (B) The procalcitonin, $P < 0.01$; ※: $P < 0.05$, †: $P > 0.05$. (C) The interleukin-6, $P = 0.02$; ※: $P < 0.05$, †: $P > 0.05$. (D) The C reactive protein, $P < 0.01$; ※: $P < 0.05$, †: $P > 0.05$.

Publisher's note

All claims expressed in this article are solely those of the authors and do not necessarily represent those of their affiliated

organizations, or those of the publisher, the editors and the reviewers. Any product that may be evaluated in this article, or claim that may be made by its manufacturer, is not guaranteed or endorsed by the publisher.